


**CITY OF LITTLE ROCK
CITY HALL RETAINING
WALL REPAIR**

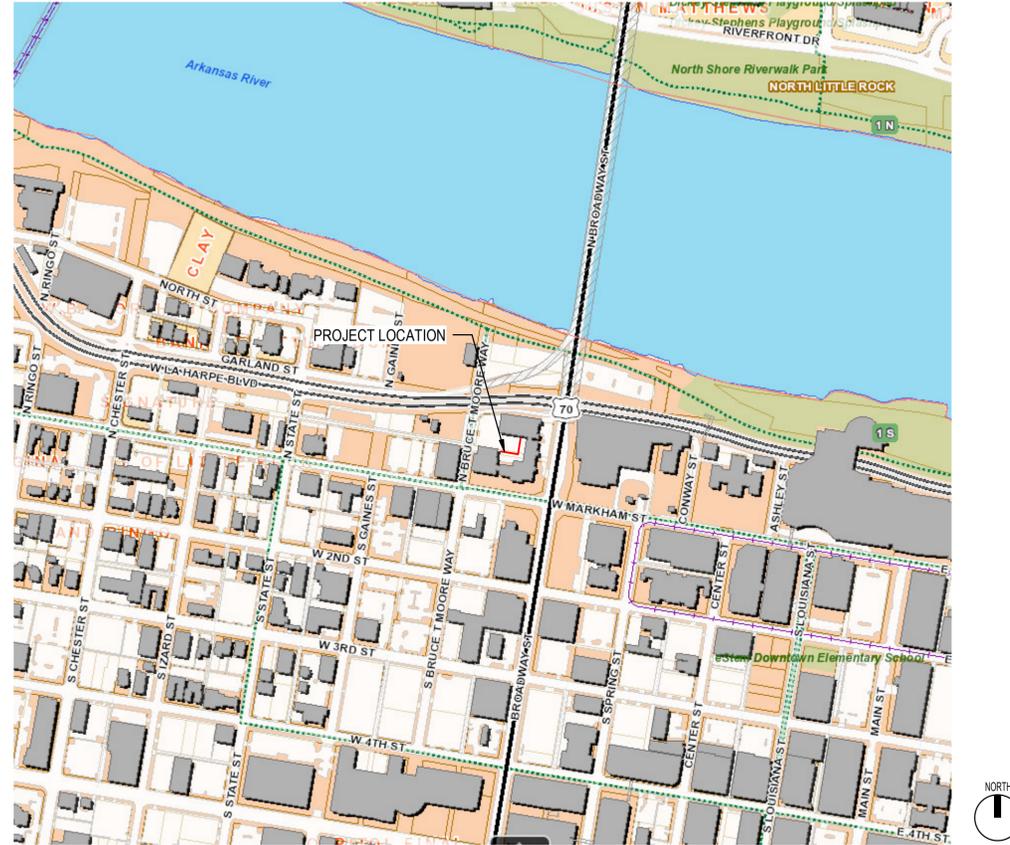

City Hall Retaining Wall Repair

500 W Markham St, Little Rock, AR 72201

Design Phase _____

**CONSTRUCTION
DOCUMENTS**

Revisions

No. Date Description

No.	Date	Description

Stamp



01-08-2026

Notes

1. CROMWELL ARCHITECTS ENGINEERS, INC. ALL RIGHTS RESERVED
2. THIS SHEET DESIGNED FOR COLOR PRINTING. CRITICAL INFORMATION MAY BE LOST WITH BLACK AND WHITE PRINTING.

Project Number _____

2025-058

Issue Date _____

01-08-2026

Sheet Title _____

TITLE SHEET

Sheet Number _____

G-001

**CITY OF LITTLE ROCK
CITY HALL RETAINING
WALL REPAIR**

**CONSTRUCTION
DOCUMENTS**

Revisions

No.	Date	Description

Stamp



Notes

1. CROMWELL ARCHITECTS ENGINEERS, INC. ALL RIGHTS RESERVED
2. THIS SHEET DESIGNED FOR COLOR PRINTING. CRITICAL INFORMATION MAY BE LOST WITH BLACK AND WHITE PRINTING.

Project Number **2025-058**

Issue Date **01-08-2026**



Sheet Title

**SITE SEDIMENTATION AND
EROSION CONTROL PLAN**

Sheet Number


CE101

LEGEND

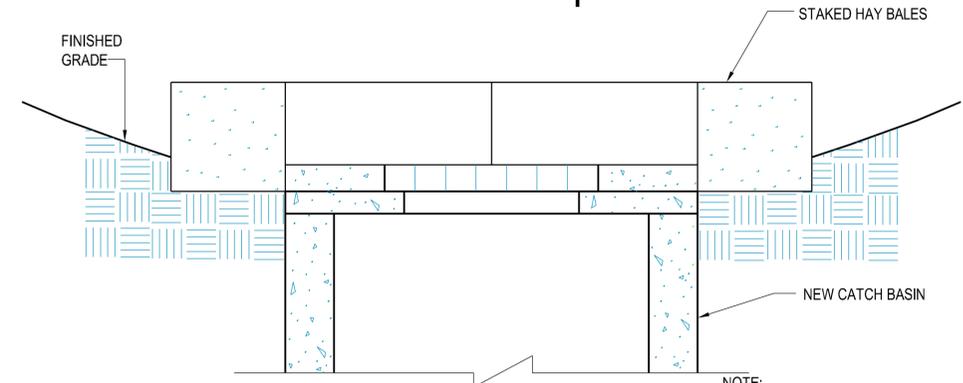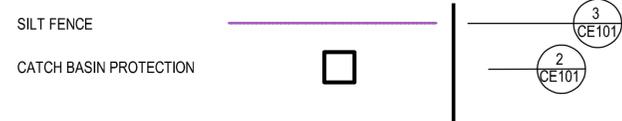


**2 STAKED HAY BALES AROUND
CATCH BASIN DETAIL**
NOT TO SCALE

NOTE:
THIS DETAIL IS FOR USE AFTER EXCAVATED
INLET PROTECTION AROUND CATCH BASIN HAS
BEEN CLOSED AND BEFORE VEGETATION HAS
BEEN ESTABLISHED.

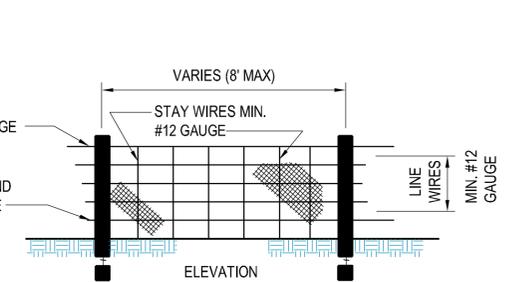


- GENERAL NOTES:**
1. SILT FENCE SHALL BE INSTALLED OUTSIDE TOE OF EARTHFILL EMBANKMENTS.
 2. WIRE SHALL BE A MINIMUM OF 32" IN WIDTH AND SHALL HAVE A MIN. OF 6 LINE WIRES WITH 12" STAY SPACING.
 3. FILTER FABRIC SHALL BE A MINIMUM OF 36" IN WIDTH AND SHALL BE FASTENED SECURELY TO THE WIRE.
 4. STEEL POSTS SHALL BE 6'-0" IN HEIGHT AND BE OF SELF-FASTENER ANGLE STEEL TYPE.
 5. CONTRACTOR SHALL PERIODICALLY REMOVE ACCUMULATED SEDIMENT, AS REQUIRED
- NOTE: THE FILTER FABRIC SHALL MEET THE FOLLOWING REQUIREMENTS:
A) EOS IS NOT LARGER THAN U.S. STANDARD SIEVE NO.70
B) GRAB STRENGTH 90-120 LB
C) CONFORM TO ASTM D-1682 OR ASTM D-177

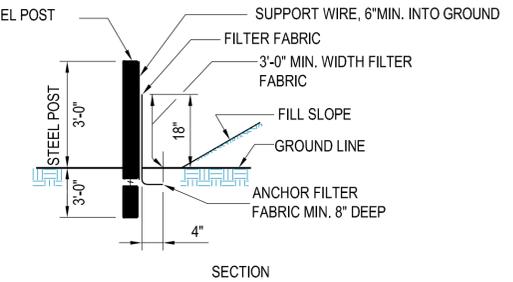

TEMPORARY SEDIMENT FENCE MAINTENANCE:

- 1) INSPECT SEDIMENT FENCES AT LEAST ONCE A WEEK AND AFTER EACH RAINFALL. MAKE ANY REQUIRED REPAIRS IMMEDIATELY.
- 2) SHOULD THE FABRIC OF A SEDIMENT FENCE COLLAPSE, TEAR, DECOMPOSE OR BECOME INEFFECTIVE, REPLACE IT PROMPTLY.
- 3) REMOVE SEDIMENT DEPOSITS AS NECESSARY TO PROVIDE ADEQUATE STORAGE VOLUME FOR THE NEXT RAIN AND TO REDUCE PRESSURE ON THE FENCE, TAKING CARE TO AVOID UNDERMINING THE FENCE DURING CLEANOUT.
- 4) REMOVE ALL FENCING MATERIALS AND UNSTABLE SEDIMENT DEPOSITS AND BRING THE AREA TO GRADE AND STABILIZE IT AFTER THE CONTRIBUTING DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.

3 TEMPORARY SEDIMENT FENCE DETAIL
NOT TO SCALE

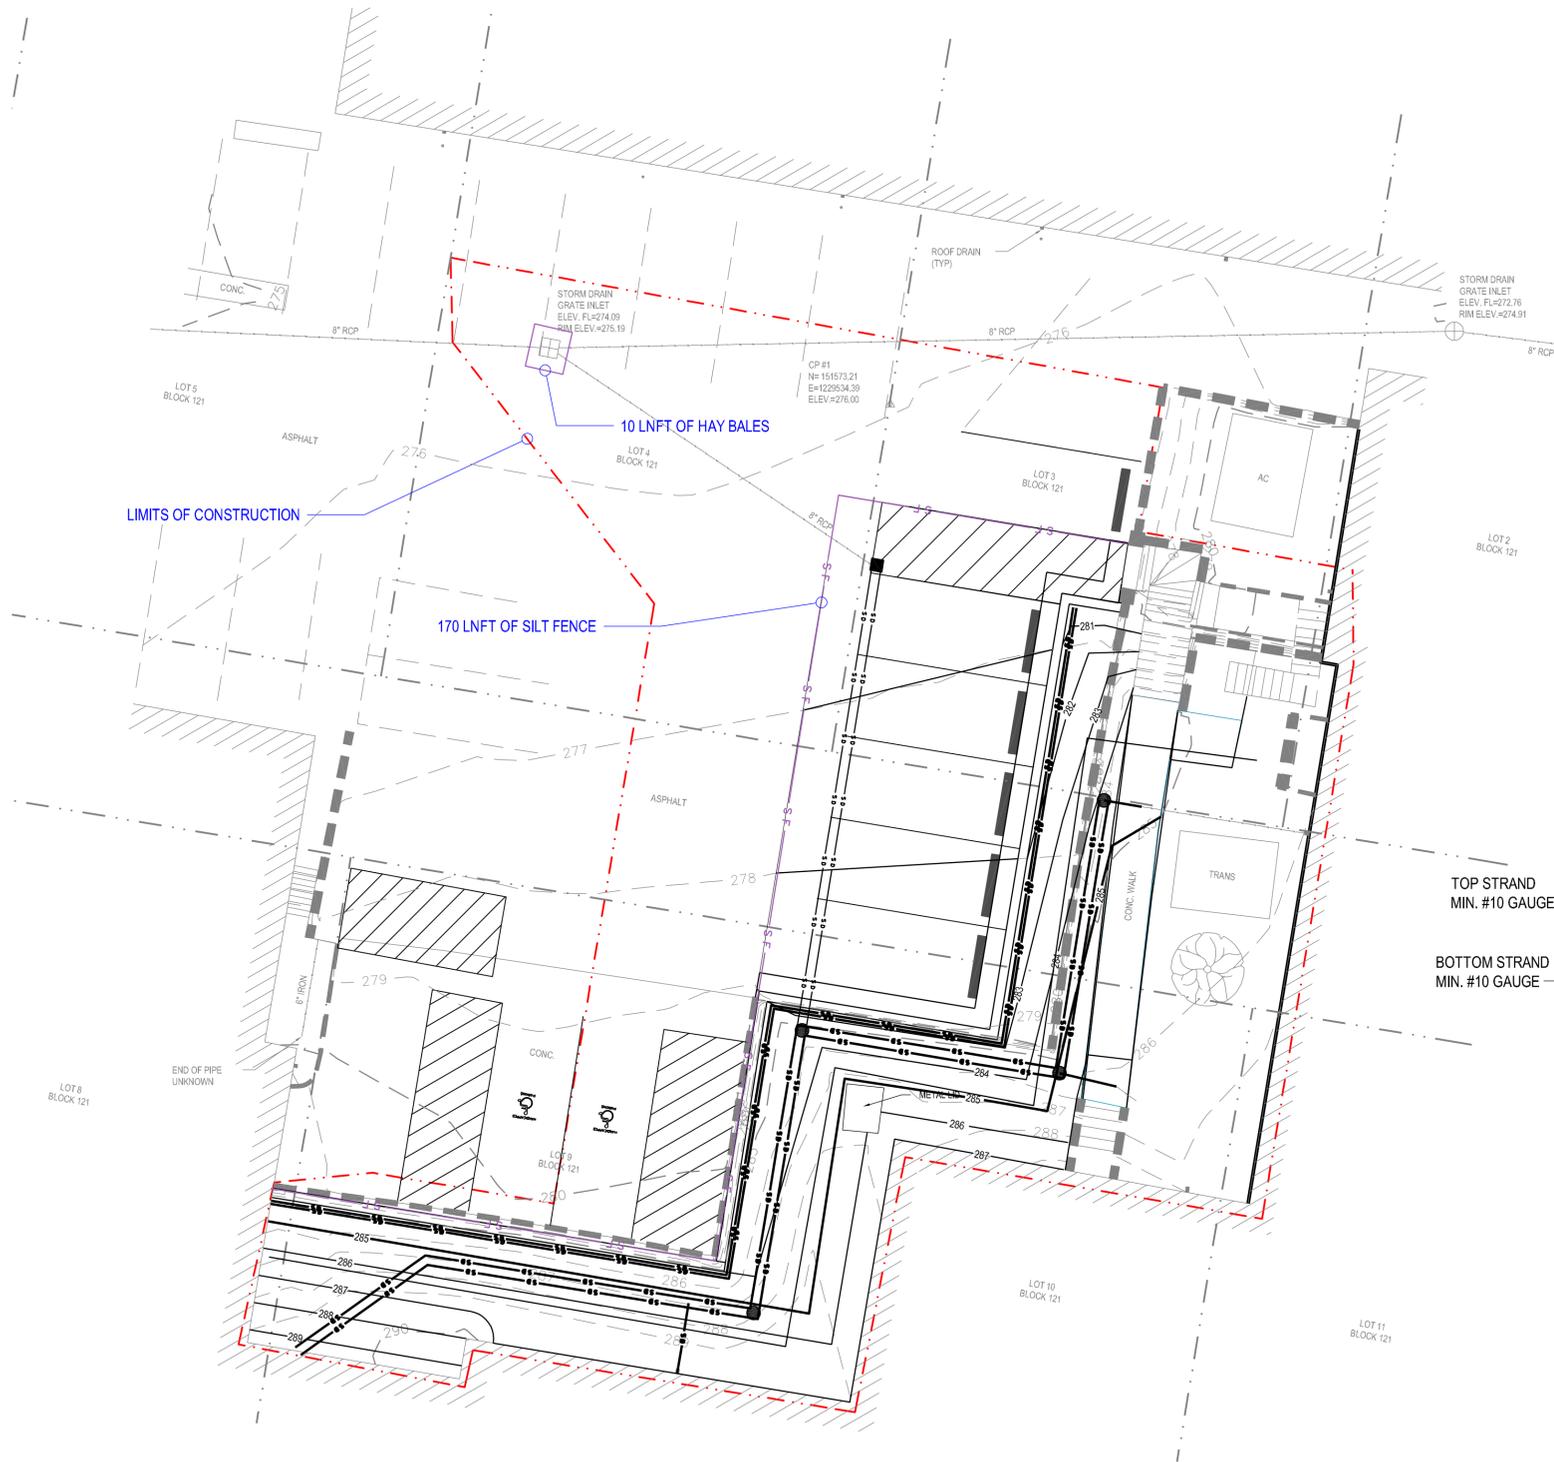


LITTLE
ROCK
CITY HALL

**SITE SEDIMENTATION AND
EROSION CONTROL PLAN**



1



SCALE: 1"= 10'



